

SECTION A-A



NOTE:
ALL CONCRETE SHALL TEST
4200 P.S.I. @ 28 DAYS

CURING COMPOUND SHALL BE APPLIED
TO ALL EXPOSED SURFACES

4" OF ITEM 304 OR 411 GRAVEL SHALL BE
PLACED UNDER SIDEWALK

NOTE:
ALL TREADS ARE TO BE
1'-0" WIDE UNLESS OTHER-
WISE SHOWN ON THE PLANS.
ALL RISERS SHALL BE OF
EQUAL HEIGHT AS DETER-
MINED BY FIELD CONDITIONS.
MAXIMUM RISER HEIGHT IS 8".




CONCRETE SIDEWALK CONSTRUCTION DETAIL

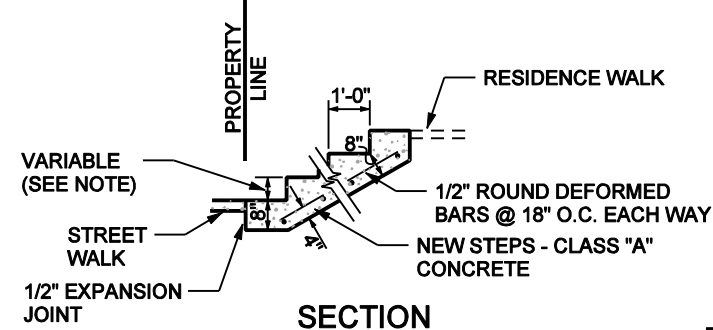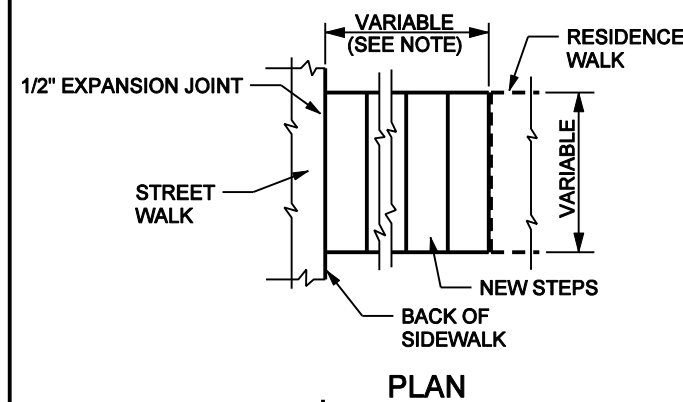

MULTIPLE STEPS

SINGLE STEP

CONCRETE STEP CONSTRUCTION DETAIL

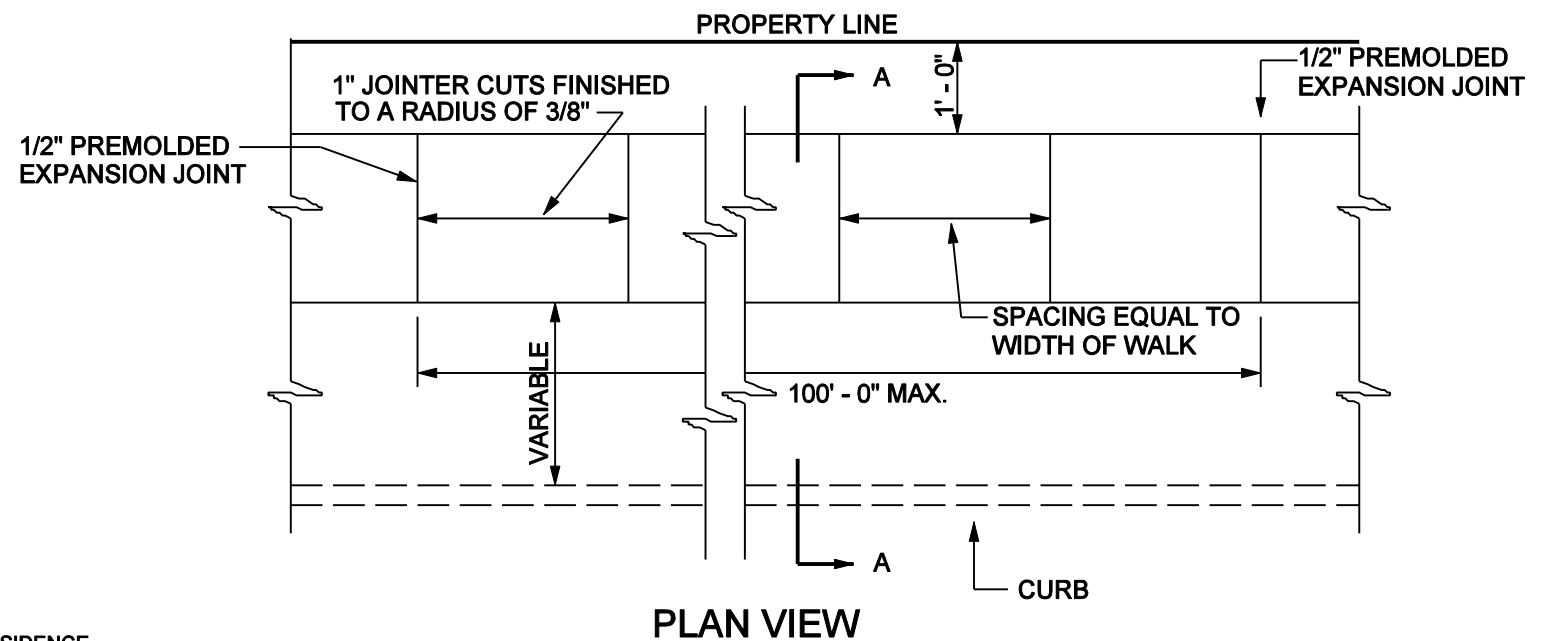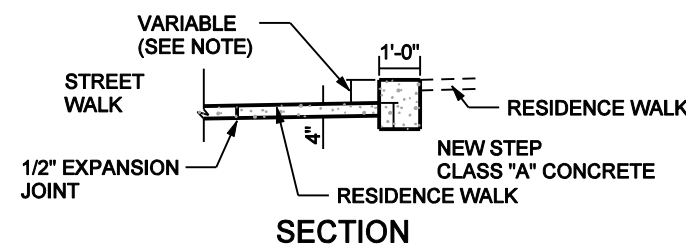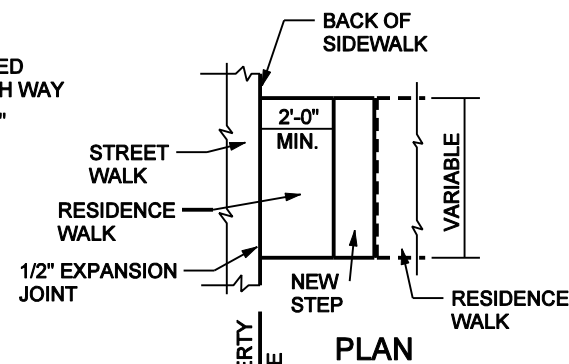

NOTES

1. PROVIDE BROOM FINISH TO ALL EXPOSED SURFACES.
2. CONCRETE SHALL CONFORM TO ITEM 500, CAST IN PLACE CONCRETE.
3. PROVIDE A MINIMUM OF 2" EDGING AROUND ALL EXPOSED SURFACES.